

 Controller Reactor1 Controller Fault Handler Power-Up Handler**Tasks** MainTask MainProgram MainRoutine Unscheduled**Motion Groups** Ungrouped Axes**Add-On Instructions****Data Types** User-Defined Strings Add-On-Defined Module-Defined AB:1756\_ENET\_10SLOT:I:0 AB:1756\_ENET\_10SLOT:O:0 AB:1756\_ENET\_7SLOT:I:0 AB:1756\_ENET\_7SLOT:O:0 AB:1756\_ENET\_SLOT:I:0 AB:1756\_ENET\_SLOT:O:0 AB:5000\_HART\_Command\_Control\_Struct:I:0 AB:5000\_HART\_Command\_Control\_Struct:O:0 AB:5000\_HART\_Static\_Struct:I:0 AB:5000\_String16\_Struct:I:0 AB:5000\_String32\_Struct:I:0 CHANNEL\_AI:I:0 CHANNEL\_AI:O:0 CHANNEL\_AI\_CAL:O:0 CHANNEL\_AI\_CJ\_DIAG:I:0 CHANNEL\_AI\_DIAG:I:0 CHANNEL\_AI\_DIAG\_CAL:I:0 CHANNEL\_AI\_HART:I:0 CHANNEL\_AO:O:0 CHANNEL\_AO\_CAL:O:0 CHANNEL\_AO\_DIAG:I:0 CHANNEL\_AO\_DIAG\_CAL:I:0 CHANNEL\_DI:I:0 CHANNEL\_DI\_COUNTER:I:0 CHANNEL\_DI\_COUNTER:O:0 CHANNEL\_DI\_TIMESTAMP:I:0 CHANNEL\_DI\_TIMESTAMP:O:0 CHANNEL\_DO:I:0 CHANNEL\_DO:O:0 CHANNEL\_DO\_DIAG:I:0 CHANNEL\_DO\_OVERRIDE:O:0 CHANNEL\_DO\_SCHEDULED:O:0 CHANNEL\_HSC:I:0 CHANNEL\_HSC:O:0


 PAX\_HART\_DEVICE:I:0

Trends

I/O Configuration

 1756 Backplane, 1756-A10


 [0] 1756-L81E Reactor1


 [5] 1756-L71 IonExc1

 [8] 1756-EN2T R1\_Subnet1

 Ethernet

 5069-L310ERM Loadout

 1756-EN2T R1\_Subnet1

 1756-EN2T R2\_Subnet1






 1756 Backplane, 1756-A10


 [0] 1756-L81E Reactor2

 [8] 1756-EN2T R2\_Subnet1

 Ethernet

 1756-L81E Reactor1

| Name  | Value      | Data Type | Scope    |
|---|------------|-----------|----------|
|  <b>CLogix_Read_Msg</b> |            | MESSAGE   | Reactor1 |
| External Access:  | Read/Write |           |          |
| <i>CLogix_Read_Msg - MainProgram/MainRoutine - *1(MSG)</i>  |            |           |          |
|  <b>Msg_Tmr</b>         |            | TIMER     | Reactor1 |
| Constant  | No         |           |          |
| External Access:  | Read/Write |           |          |
| <i>Msg_Tmr - MainProgram/MainRoutine - *0(TON)</i>  |            |           |          |
| <b>Msg_Tmr.DN</b>   | 0          | BOOL      |          |
| <i>Msg_Tmr.DN - MainProgram/MainRoutine - 0(XIO), 1(XIC), 2(XIC)</i>                                  |            |           |          |
|  <b>R1_Cmd</b>          | 0          | INT       | Reactor1 |
| Constant  | No         |           |          |
| External Access:  | Read/Write |           |          |
| <i>R1_Cmd - MainProgram/MainRoutine - 2(MSG)</i>  |            |           |          |
|  <b>React2_Indicat</b>  | 0          | DINT      | Reactor1 |
| Constant  | No         |           |          |
| External Access:  | Read/Write |           |          |
| <i>React2_Indicat - MainProgram/MainRoutine - *1(MSG)</i>   |            |           |          |
|  <b>SLC_Write_Msg</b>   |            | MESSAGE   | Reactor1 |
| External Access:  | Read/Write |           |          |
| <i>SLC_Write_Msg - MainProgram/MainRoutine - *2(MSG)</i>  |            |           |          |

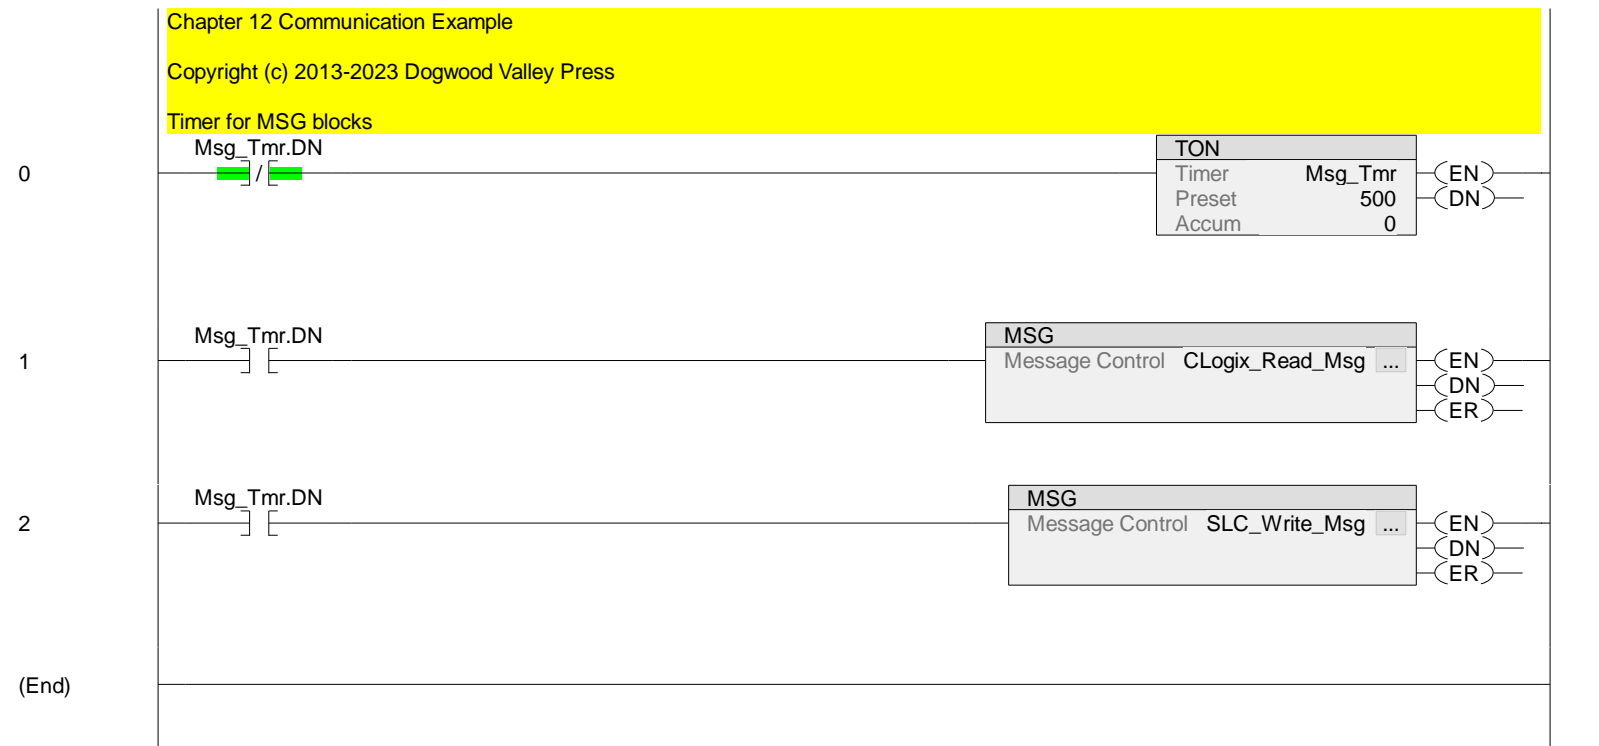

|                            |   |
|----------------------------|---|
| <b>Reactor1</b>            |   |
| Label does not exist ..... | 1 |
| Tag Listing.....           | 3 |
| <b>MainTask</b>            |   |
| <b>MainProgram</b>         |   |
| <b>MainRoutine</b>         |   |
| Ladder Diagram .....       | 4 |