

## Main\_Program [OB1]

### Main\_Program Properties

#### General


<b>Name</b>	Main_Program	<b>Number</b>	1	<b>Type</b>	OB
<b>Language</b>	LAD	<b>Numbering</b>	Manual		

#### Information


<b>Title</b>	"Main Program Sweep (Cycle)"	<b>Author</b>		<b>Comment</b>	Example 5.5 - Monitor pump run time  Copyright (c) 2013 Dogwood Valley Press, LLC
<b>Family</b>		<b>Version</b>	0.1	<b>User-defined ID</b>	

Name	Data type	Default value
▼ Temp		
OB1_EV_CLASS	Byte	
OB1_SCAN_1	Byte	
OB1_PRIORITY	Byte	
OB1_OB_NUMBR	Byte	
OB1_RESERVED_1	Byte	
OB1_RESERVED_2	Byte	
OB1_PREV_CYCLE	Int	
OB1_MIN_CYCLE	Int	
OB1_MAX_CYCLE	Int	
OB1_DATE_TIME	Date_And_Time	
Constant		

### Network 1: Generates tic for retentive timer

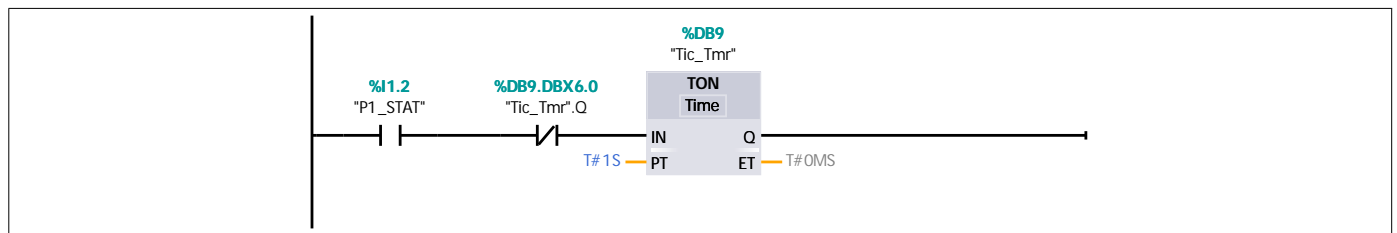

### Network 2: Counter to retain pump run time. Counts seconds

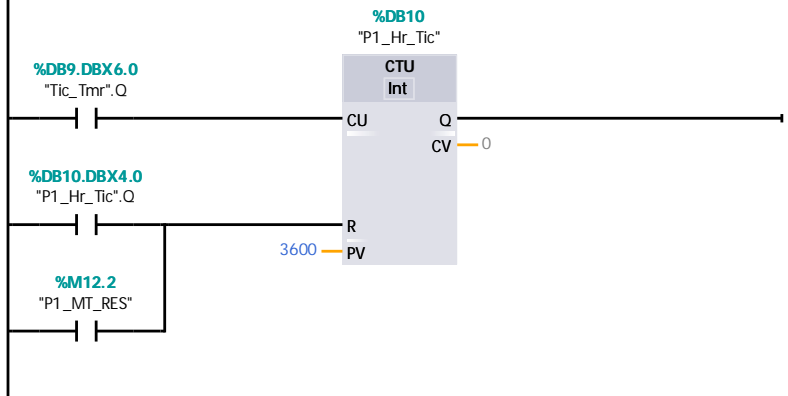

Network 3: Count hours of run time

