


Example 7.4 - Simple tank level control


Copyright (c) 2015 Dogwood Valley Press, LLC

Convert level measurement into units of feet

0000

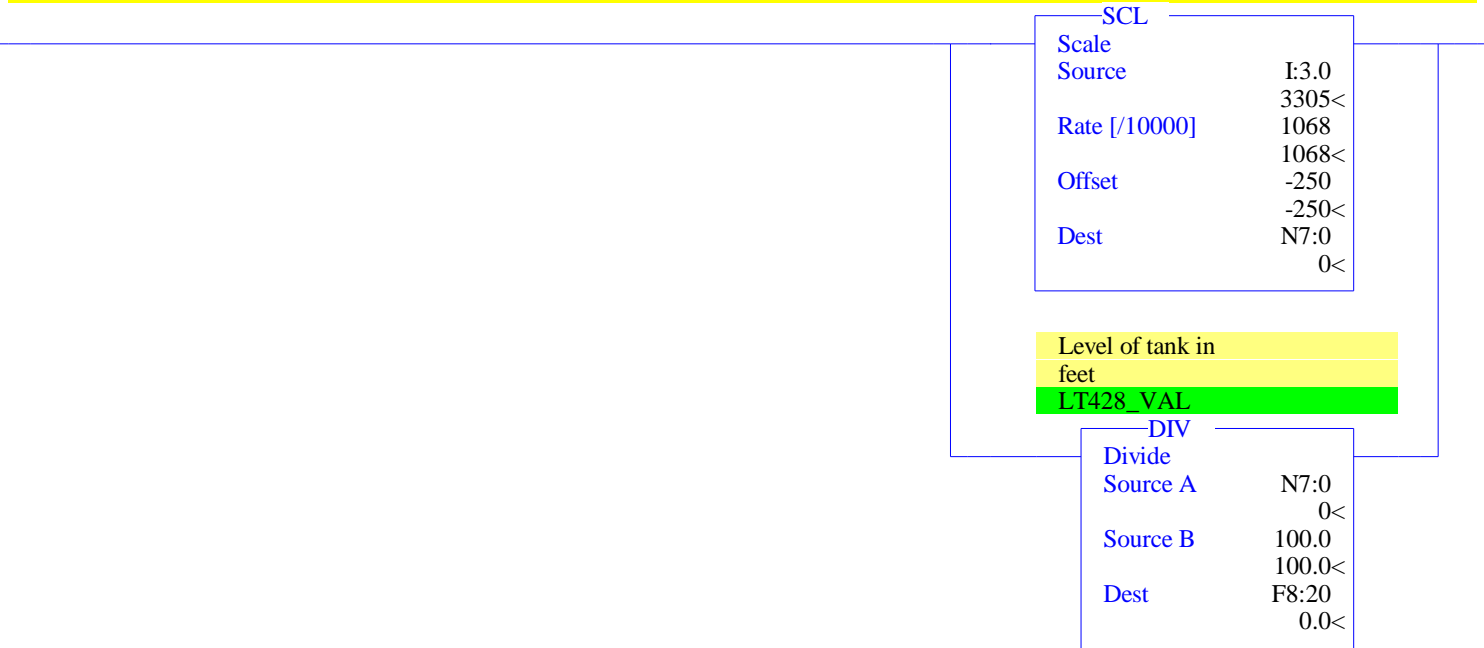

0001

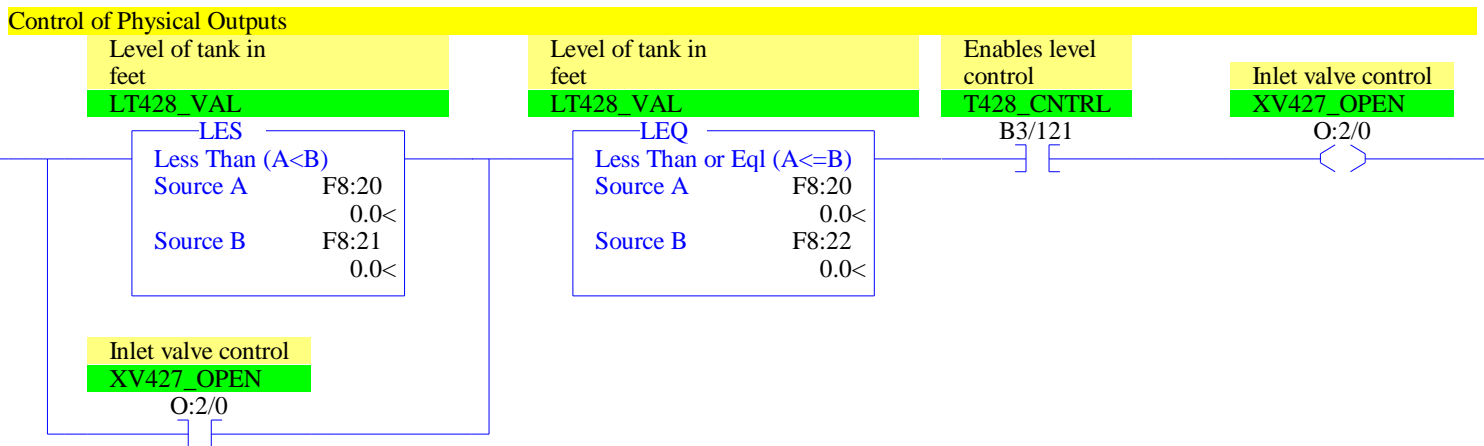

0002

END

RSLogix 500 Cross Reference Report - Sorted by Address

O:2/0	- {XV427_OPEN} Inlet valve control OTE - File #2 - 1 XIC - File #2 - 1
I:3.0	- {LT428_MEAS} Level measurement SCL - File #2 - 0
B3/121	- {T428_CNTRL} Enables level control XIC - File #2 - 1
N7:0	- DIV - File #2 - 0 SCL - File #2 - 0
F8:20	- {LT428_VAL} Level of tank in feet DIV - File #2 - 0 LES - File #2 - 1 LEQ - File #2 - 1
F8:21	- {T428_MIN} Minimum tank level for control LES - File #2 - 1
F8:22	- {T428_MAX} Maximum tank level for control LEQ - File #2 - 1